



Multi-Pure's Superior Performance Confirmed by Testing and Certification

The effectiveness of any drinking water treatment device is measured by the performance of its filter. NSF testing in accordance with NSF/ANSI standards provides the consumer with the highest level of assurance that certified products will perform as claimed. A close review of NSF Listings shows that Multi-Pure's solid carbon block filters are the most effective for reducing a broad spectrum of contaminants of aesthetic as well as health concern.


NSF Listings by Standard

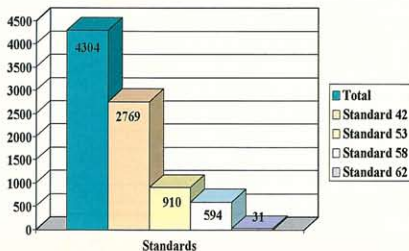

NSF Listings by Single Contaminant

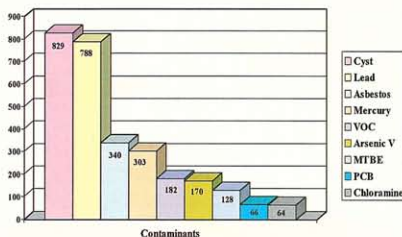

Listings by Combinations of Contaminants

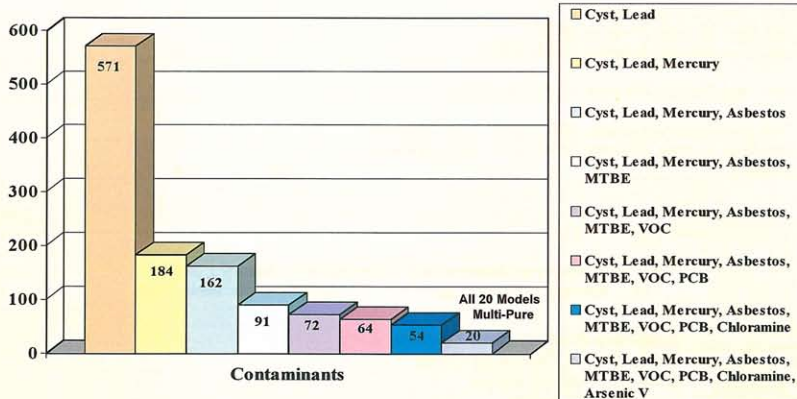

Comparing Drinking Water Systems Certified Performance Says It All

Testing programs and standards developed by NSF International provide a basis for evaluating and comparing drinking water treatment units. Although thousands of drinking water systems have been tested and certified, only a few are certified to reduce a wide range of contaminants. These charts summarize NSF Listings by standard, by single contaminants, and by combinations of contaminants.

Only Multi-Pure Drinking Water Systems are certified to reduce Lead, Mercury, Cyst, Asbestos, VOC, MTBE, PCB, Chloramine, and Arsenic V. By carefully reviewing the certification of a product, consumers can make an informed decision about the drinking water treatment device that will provide the performance they need.

NSF Listings by Standard

By Standard	Products	Companies
Aesthetics, Standard 42	2769	161
Health Effects, Standard 53	910	87
Reverse Osmosis, Standard 58	594	74
Distillation, Standard 62	31	3
Total	4304	325

NSF Listings by Contaminant

Single Contaminants	Health Effects	Number of Products			Total
		Reverse Osmosis	Distillers		
Cyst	671	158	0	829	
Lead	585	172	31	788	
Asbestos	329	11	0	340	
Mercury	270	2	31	303	
VOC	171	11	0	182	
Arsenic V	20	119	31	170	
MTBE	124	4	0	128	
PCB	66	0	0	66	
Chloramine	64	0	0	64	

NSF Listings by Combinations of Contaminants

Combination of Contaminants	Health Effects	Number of Products			Total
		Reverse Osmosis	Distillers		
Cyst, Lead	425	146	0	571	
Cyst, Lead, Mercury	182	2	0	184	
Cyst, Lead, Mercury, Asbestos	162	0	0	162	
Cyst, Lead, Mercury, Asbestos, MTBE	91	0	0	91	
Cyst, Lead, Mercury, Asbestos, MTBE, VOC	72	0	0	72	
Cyst, Lead, Mercury, Asbestos, MTBE, VOC, PCB	64	0	0	64	
Cyst, Lead, Mercury, Asbestos, MTBE, VOC, PCB, Chloramine	54	0	0	54	
Cyst, Lead, Mercury, Asbestos, MTBE, VOC, PCB, Chloramine, Arsenic V	20	0	0	20	

All 20 models
Multi-Pure

Charts are based on NSF online listings on January 1, 2004.
For more information, go to NSF International website: www.nsf.org



Multi-Pure Drinking Water Systems

The Las Vegas Technology Center
7251 Cathedral Rock Drive
Las Vegas, NV 89128
866-622-9373

MULTI-PURE, www.multipureplus.com